


UPSTREAM CHANNEL SHALL BE SIZED TO ACCOMMODATE THE 100YR STORM.

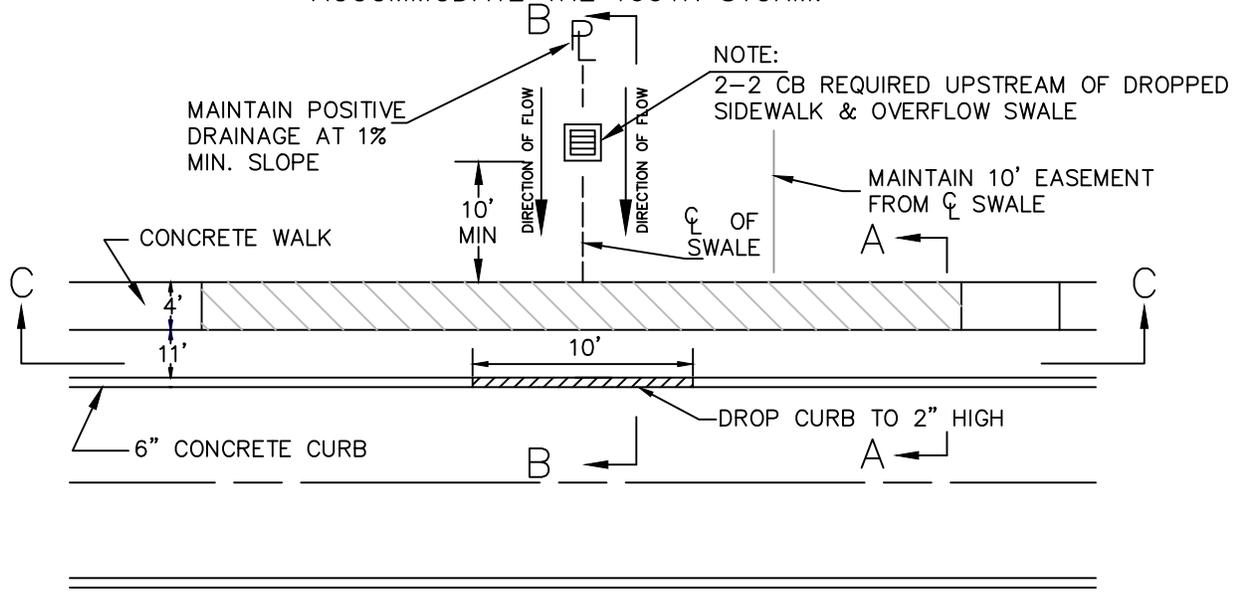

MAINTAIN POSITIVE DRAINAGE AT 1% MIN. SLOPE

NOTE: 2-2 CB REQUIRED UPSTREAM OF DROPPED SIDEWALK & OVERFLOW SWALE

MAINTAIN 10' EASEMENT FROM CL SWALE

CONCRETE WALK

10' MIN

DIRECTION OF FLOW

DIRECTION OF FLOW

CL OF SWALE

C

4'

11'

10'

A


C

6" CONCRETE CURB

B

DROP CURB TO 2" HIGH

A

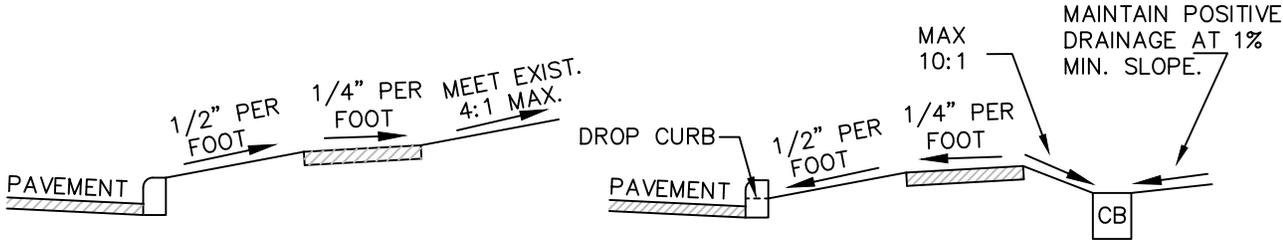

SECTION "A-A"
NORMAL SECTION

SECTION "B-B"
UPSTREAM SECTION

MAX 10:1

MAINTAIN POSITIVE DRAINAGE AT 1% MIN. SLOPE.

1/2" PER FOOT

1/4" PER FOOT

MEET EXIST. 4:1 MAX.

DROP CURB


1/2" PER FOOT

1/4" PER FOOT

CB

PAVEMENT

PAVEMENT

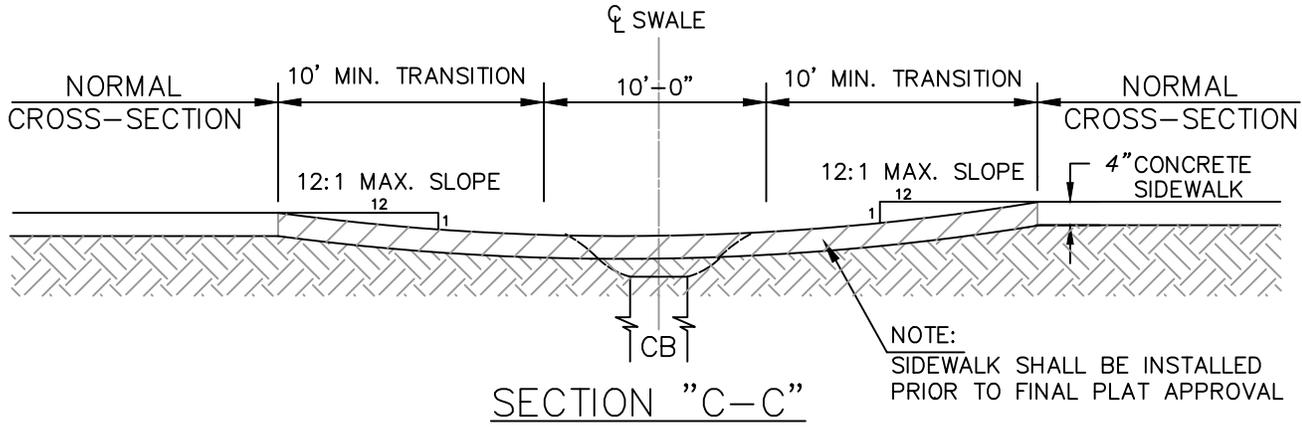

SECTION "C-C"

NOT TO SCALE

NOTE: SIDEWALK SHALL BE INSTALLED PRIOR TO FINAL PLAT APPROVAL